


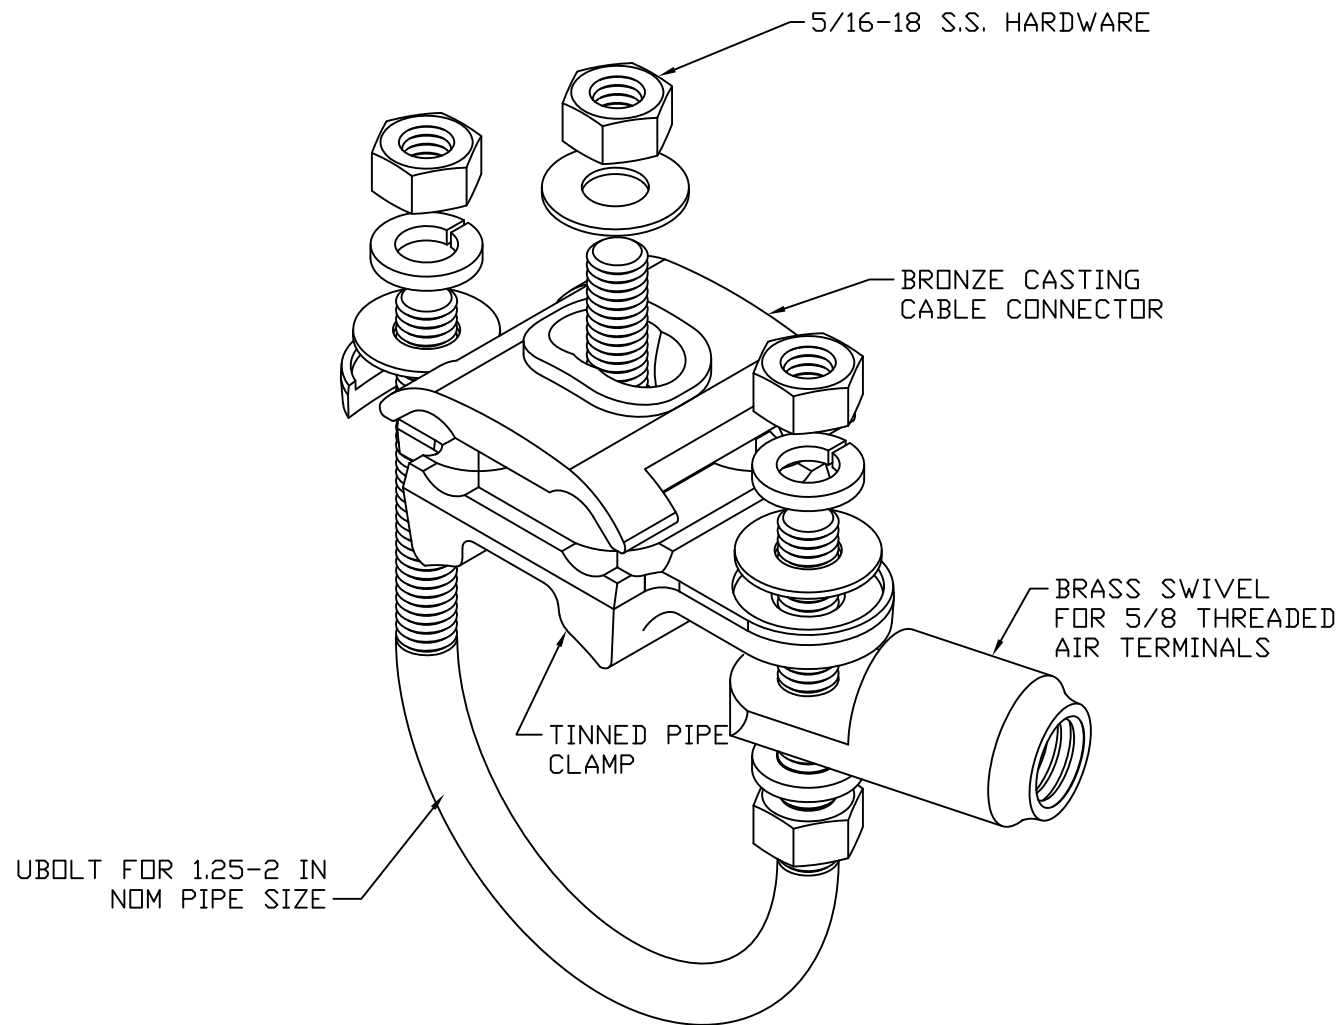

**1 1/2- 2" PIPE CLAMP
FOR 5/8" AIR TERMINAL**

EST WT 0.95#

APPROVED

☐ AS DRAWN: _____

☐ AS NOTED: _____

DATE: _____

THIS DOCUMENT AND THE CONTENTS THEREOF IS THE PROPERTY OF HARGER INC., AND IS FURNISHED TO YOU FOR INFORMATION ONLY. THE INFORMATION CONTAINED HEREIN IS CONFIDENTIAL AND OF A PROPRIETARY NATURE AND MUST NOT BE DISCLOSED TO THIRD PARTIES WITHOUT THE EXPRESS WRITTEN APPROVAL OF HARGER INC.

A	ADDED MARKING ECO 0116	091216	LAL		
LET	REVISION	DATE	BY		
TOLERANCES UNLESS NOTED:					
	FRACTIONAL	+/- 1/16			
		+/- .030			
		+/- .010			
		3RD ANGLE PROJECTION			

PART NO. CPRB1.5/2AT58
TINNED CU PIPE RAIL BASE 1.5/2

DRAWN BY:
BK

CHECKED BY:
—

DATE:
122111

HARGER™

301 ZIEGLER DRIVE
GRAYSLAKE, IL 60030
(847) 548-8700

REVISION:
A

SCALE:
—

SHEET:
1 OF 1